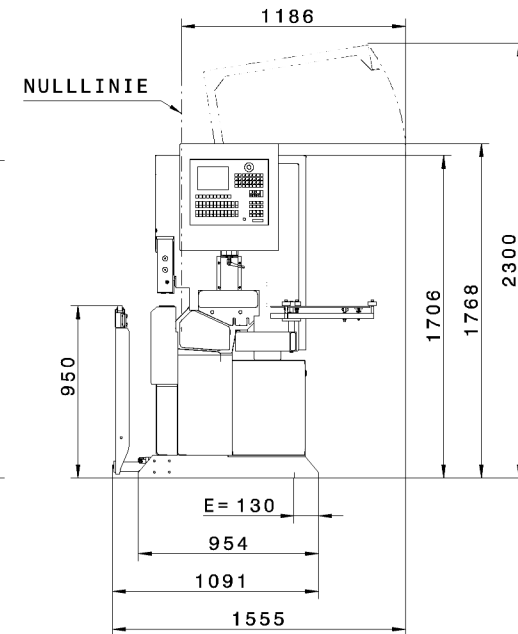
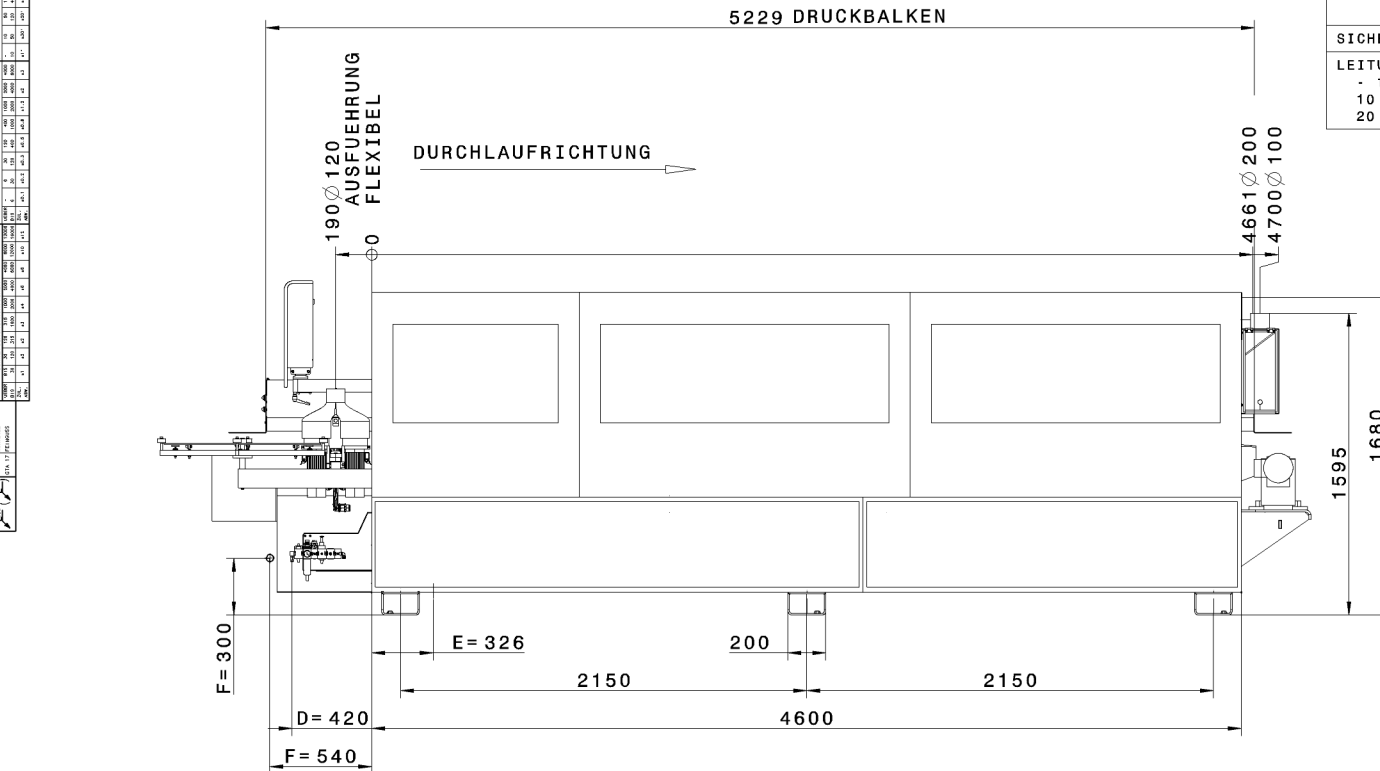


Passmaß	Abmaß
---------	-------

	EMPFOHLENE VORSICHRUNG					
	QUERSCHNITTS- FLAECHE ..MM2					
SICHERUNG	16 A	20 A	25 A	35 A	50 A	63 A
LEITUNGSLAENGE						
- 10 m	2.5 mm ²	2.5 mm ²	4.0 mm ²	6.0 mm ²	10.0 mm ²	16.0 mm ²
10 - 20 m	2.5 mm ²	4.0 mm ²	4.0 mm ²	6.0 mm ²	10.0 mm ²	16.0 mm ²
20 - 30 m	2.5 mm ²	4.0 mm ²	6.0 mm ²	10.0 mm ²	16.0 mm ²	16.0 mm ²


$$E = \frac{\text{ELEKTROANSCHLUSS}}{\text{BETRIEBSSPANNUNG}}$$

400V - 3PH -  - 50HZ

GESAMTANSCHLUSSWERT
31 KW

NENNSTROM
45 A

GEWICHT
CA. 3000KG

D= DRUCKLUFTANSCHLUSS
6BAR / $\phi 1/2"$

GESAMTABSAUGELEISTUNG
5090 M3/H

F= KUNDENSEITIG

DRUCKLUFTVERSORGUNG

AIRTEC

8BAR / $\phi 1/2''$

LUFTVERBRAUCH AIRTEC

1500 Nl/min

LUFTGESCHWINDIGKEIT
28M/SEC

DRUCKVERLUST
CA. 2000PA

LUFTVERBRAUCH

350 Nl/min

